LUMINAIRE SCHEDULE

LUMINAIRE	DESCRIPTION	MANUFACTURER	CATALOG #	LAMP DATA NO	LAMP DATA TYPE	INPUT WATTS	VOLTAGE	MOUNT
F1	2'X2' LENSED TROFFER,	COLUMBIA	4PS22-2170-FSA12-E86	2	32W/T8	40	120	RECESSED IN GRID CEILING.
F2	2'X2' LENSED TROFFER,	COLUMBIA	4PS22-3200G-FSA12-E86	2	32W/T8/A-BENT	40	120	RECESSED IN GRID CEILING.
F3	2'X2' LENSED TROFFER,	COLUMBIA	4PS22-3200G-FSA12-E86	2	32W/T8/A-BENT	80	120	RECESSED IN GRID CEILING.
S2	1'X4' SURFACE MOUNT	COLUMBIA	PM14-232-FSA12-E86	2	32W/T8	80	120	SURFACE ON GRID OR GYPBOARD CEILING.
S3	1'X4' SURFACE MOUNT (ON EMERGENCY CIRCUIT)	COLUMBIA	PM14-232-FSA12-E86	2	32W/T8	80	120	SURFACE ON GRID OR GYPBOARD CEILING.
W1	4' WALL BRACKET	COLUMBIA	W4-232-E86	2	32W/T8	80	120	WALL SURFACE
F4	2'X4' LENSED TROFFER,	COLUMBIA	4PS24-2320-FSA12-E86	2	32W/T8	80	120	RECESSED IN GRID CEILING.
F5	2'X4' LENSED TROFFER,	COLUMBIA	4PS24-3320-FSA12-E86	3	32W/T8	120	120	RECESSED IN GRID CEILING.
F6	2'X4' LENSED TROFFER, (ON EMERGENCY CIRCUIT)	COLUMBIA	4PS24-3320-FSA12-E86	2	32W/T8	80	120	RECESSED IN GRID CEILING.
D1	6" DIA. FLOUR. OPEN DOWNLIGHT	PRESCOLITE	CF16326ED-SIFR926I	1	26T4-CF	80	120/277	RECESSED IN GRID OR GYPBOARD CEILING
D2	6" DIA. FLOUR. OPEN DOWNLIGHT (ON EMERGENCY CIRCUIT)	PRESCOLITE	CF16326ED-SIFR926I	1	26T4-CF	80	120/277	RECESSED IN GRID OR GYPBOARD CEILING
D3	10" SQ. LUMASQUARE	HUBBELL	MRG-456	2	28W-PLC	60	120	CEILING SURFACE
E1	EXIT W/BATTERY BACK-UP	ENERGOLITE	PLUMB2S4R	2	7WPL	7	120/277	CEILING OR WALL MOUNTED
E2	EMERG. W/BATTERY BACK-UP	ENERGOLITE	12.5-C-36-2	2	INCLUDED	9	120/277	CEILING OR WALL MOUNTED
K1	ROUND MOLDED ACRYLIC	LITHONIA	1009H	1	13DTT	13	120	CEILING SURFACE
K2	HVG HERCULES FLOUR.	HUBBELL	HVGS-32F9-1	1	32W	32	120	CEILING SURFACE
K3	WALL PARK	LITHONIA	TWH-100M-120	1	100W-MH	100	120	CEILING SURFACE
W1	6"DIA. WALL WASH	PRESCOLITE	CF7W26EBDM	1	26WTT	30	120	RECESSED IN GRID OR GYPBOARD CEILING
C1	CHANDELIER	SEAGULL	6173-025	1	60W-C	240	120	PENDANT
C2	CHANDELIER	SEAGULL	5116-02	1	60W-C	180	120	PENDANT
S2 T1 S2	TRACK FLOOD	CAPRI	KT3440	2	100W PAR38	100	120	SURFACE

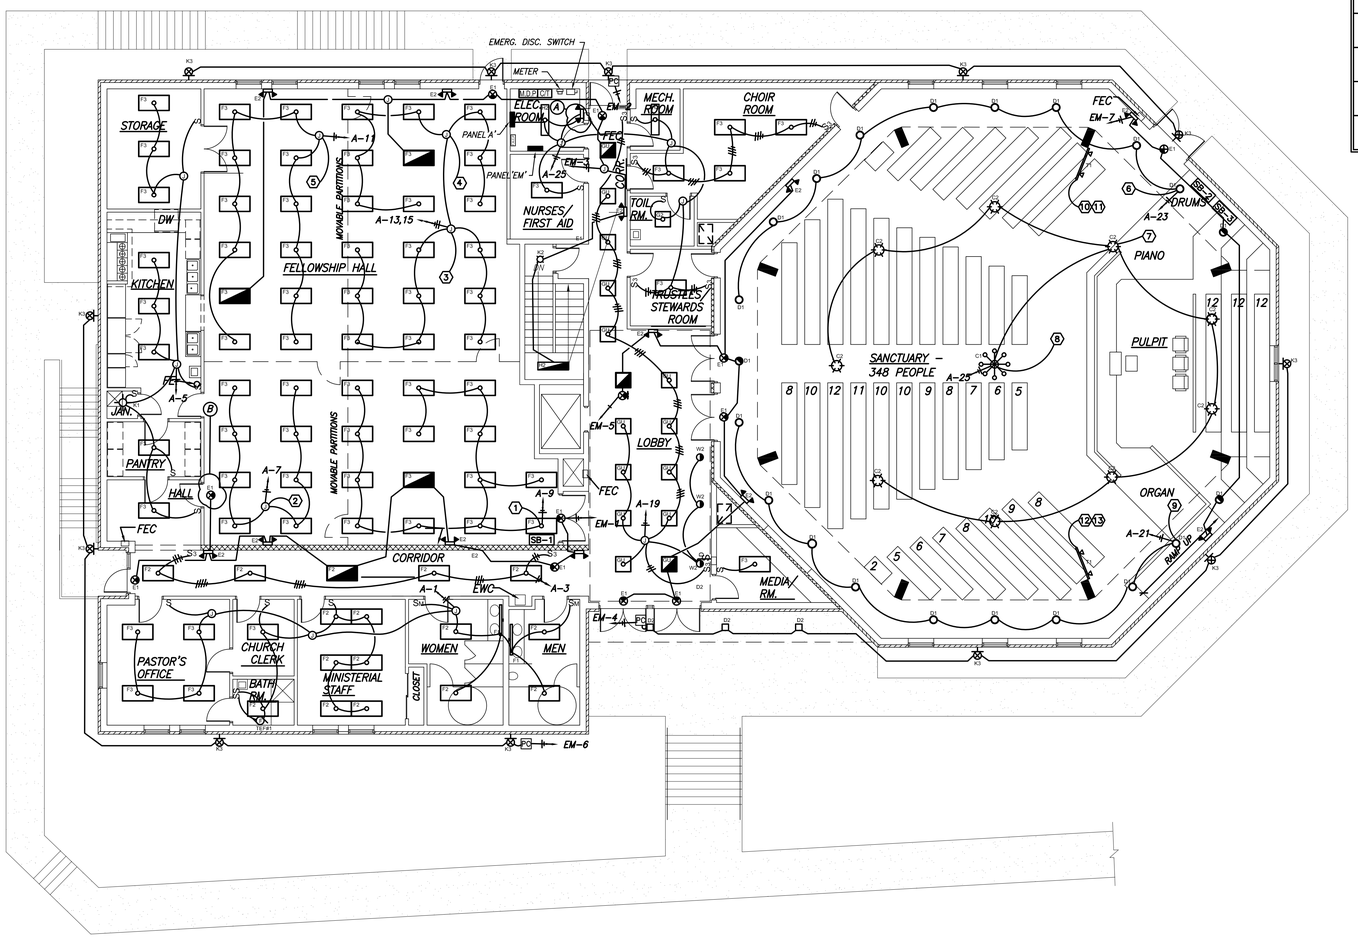

SYMBOL LEGEND

SB-1 – SWITCH BANK, 48" A.F.F.

SB-2 – DIMMER BANK, 48" A.F.F.

SB-3 – DIMMER BANK, 48" A.F.F.

S – SINGLE POLE SWITCH, 48" A.F.F.

S3 – THREE-WAY SWITCH, 48" A.F.F.

SM – SINGLE POLE OCCUPANCY SENSOR SWITCH W/MANUAL OVERRIDE & 30 MINUTE-DURATION ,48" A.F.F.

D – DIMMER SWITCH, 48" A.F.F.

PC – PHOTOCONTROL SWITCH

– JUNCTION BOX

– BRANCH CIRCUIT HOMERUN TO PANELBOARD, NUMBER OF ARROWS INDICATES NUMBER OF CIRCUITS. FULL SLASHES INDICATE UNGROUNDED "HOT" CONDUCTORS. HALF SLASHES INDICATE GROUNDED NEUTRAL CONDUCTOR(S). DOT INDICATES EQUIPMENT GROUNDING CONDUCTOR.

– BRANCH CIRCUIT WIRING CONCEALED IN WALLS OR CEILING. NO SLASHES INDICATE ONE "HOT", ONE NEUTRAL AND EQUIPMENT GROUNDING CONDUCTORS.

– EMERGENCY BRANCH CIRCUIT WIRING. NO SLASHES INDICATE ONE "HOT", ONE NEUTRAL AND EQUIPMENT GROUNDING CONDUCTORS.

SWITCH BANK INFORMATION	
SB-1	1 2 3 4 5
SB-2	6 7 8 9
SB-3	10 11 12 13

SWITCH-LEG CIRCUIT-RUN

GROUND FLOOR PLAN – LIGHTING

SCALE: 1/8"=1'-0"

Copyright 2004 Philip Aaron Lacy, Architect. All rights reserved. No portion of this document may be reproduced without written permission.

Revisions:

		Date:
4	PERMIT	10-3-07
5	PERMIT	01-8-08
A	PERMIT	11/06/08

Engineers:

CHARLES FORD & ASSOCIATES
CONSULTING – ENGINEERS & PLANNERS
4206 GEORGIA AVE., N.W. WASH., D.C. (202) 722-4100

Certification:

Project Title:

BETH SHALOM A.M.E. ZION CHURCH
2501 RITCHIE ROAD
DISTRICT HEIGHTS, MARYLAND 20735

GROUND FLOOR PLAN – LIGHTING

Philip Aaron Lacy, Architect
4013 21st. Place
Temple Hills, Maryland 20748
Phone: 301-894-7979

Date:	NOV. 29, 2005
Scale:	1/8"=1'-0"
Drawn:	PAL
Checked:	C.FORD
File No.	BETH_A01

Drawing No.

E-3

– of –