

POWER PLAN (MEZZANINE)
SCALE: 1/4" = 1'-0"


POWER PLAN NOTES

- RECEPTACLES: DUPLEX (2P, 3W, 20A, 125V) - BRYANT 5362, GFI (2P, 3W, 20A, 125V) - BRYANT GFR53, +18" A.F.F. UNLESS OTHERWISE NOTED. COLOR AND DEVICE PLATE SHALL BE WHITE.
- FURNISHED WITH BUILT-IN DISCONNECT SWITCH.
- FOR COPIER, COORDINATE EXACT LOCATION WITH OWNER.
- FOR FAX AND/OR PRINTER, COORDINATE EXACT LOCATION WITH OWNER.
- FOR AV EQUIPMENT, COORDINATE EXACT LOCATION WITH OWNER.
- PROVIDE 3/4" E.C. WITH PULL STRING UNDER FLOOR TO NEAREST WALL, THEN UP TO ABOVE CEILING THEN THROUGH CEILING TO AV ROOM.
- COORDINATE QUANTITY AND LOCATION OF DUCT DETECTORS AND SPRINKLER RELATED SWITCHES WITH HVAC AND SPRINKLER EQUIPMENT.

FIRE ALARM NOTES

- WHERE MULTIPLE STROBES ARE LOCATED WITHIN VIEWING PROXIMITY, PROVIDE EQUIPMENT TO SYNCHRONIZE FLASHING OF STROBES.
- COORDINATE EXACT QUANTITY AND LOCATION OF SPRINKLER RELATED DEVICES WITH SPRINKLER SYSTEM WORKING DRAWINGS. MAKE ADJUSTMENTS TO FIRE ALARM SYSTEM EQUIPMENT TO COORDINATE WITH SPRINKLER SYSTEM AS NEEDED.
- SEE HVAC DRAWINGS FOR QUANTITY AND LOCATION OF DUCT MOUNTED SMOKE DETECTORS.
- FOR EVACUATION ALARM, PROVIDE SPEAKERS WITH SELECTABLE POWER RATING TO ADJUST SOUND OUTPUT OF BETWEEN 80 AND 90 DBA (@ 10 FT.). VOLTAGE RATED FOR 25V OR 70.7 VOLTS AND MINIMUM OF 400 TO 40,000 HZ FREQUENCY RESPONSE RANGE.

POWER AND SIGNAL PLAN
SCALE: 1/4" = 1'-0"

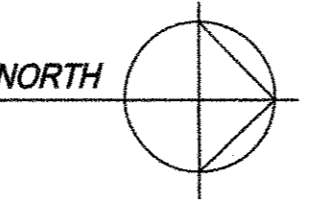


Date:	
Revisions:	
Consultants:	

Project Title:
MIRACLE TEMPLE ASSEMBLY OF GOD
14111 ALBERTON ROAD
SILVER SPRING, MARYLAND 20906

Philip Aaron Lacy, Architect
6188 Oxon Hill Road, Suite 303
Oxon Hill, Maryland 20745
Phone: 301-567-8223

Date: OCTOBER 12, 2010
Scale: 1/4" = 1'-0"
Drawn: ST
Checked: RW
File No. F:\PROJ\2010\10003

Drawing No.
E - 3
of

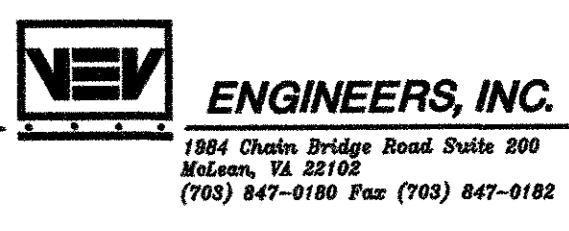

Copyright 2005 Philip Aaron Lacy, Architect. All rights reserved. No portion of this document may be reproduced without written permission.